


AUDIMUTE ACOUSTICOLOR® ACOUSTIC CEILING CLOUD

TEST REPORT

SOUND ABSORPTION REPORT RAL-A17-297

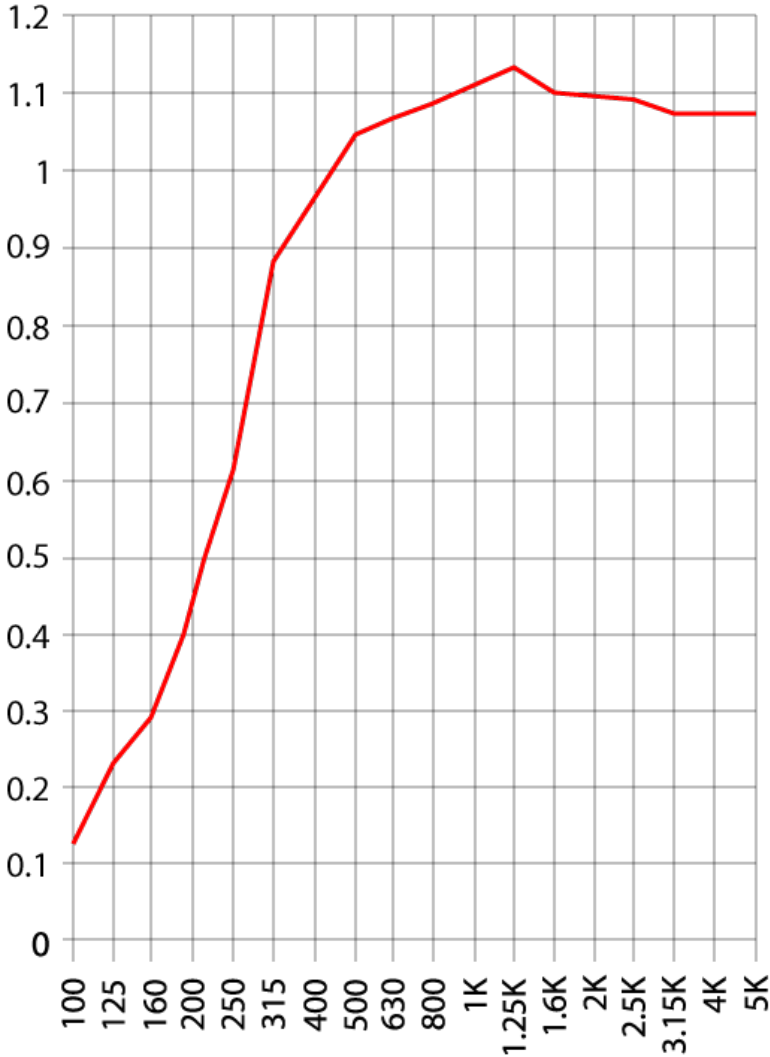

FREQUENCY (Hz)

SAA=0.97

NRC=0.95

Frequency (Hz)	Absorption Coefficient
100	0.13
125	0.23
160	0.29
200	0.43
250	0.62
315	0.87
400	0.96
500	1.04
630	1.07
800	1.09
1000	1.11
1250	1.14
1600	1.10
2000	1.10
2500	1.09
3150	1.06
4000	1.07
5000	1.06

TEST Report Audimute AcoustiColor® Acoustic Ceiling Cloud

The test report quotes the frequency dependent sound absorption data as well as the single number ratings. Data taken from Test Report RAL-A17-297 conducted by Riverbank Acoustical Laboratories. Complete test results are available upon request.